

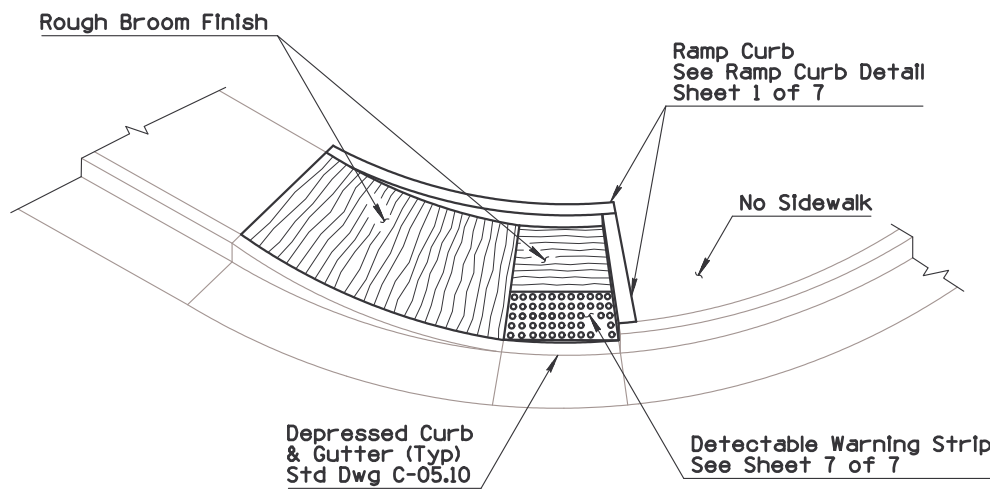
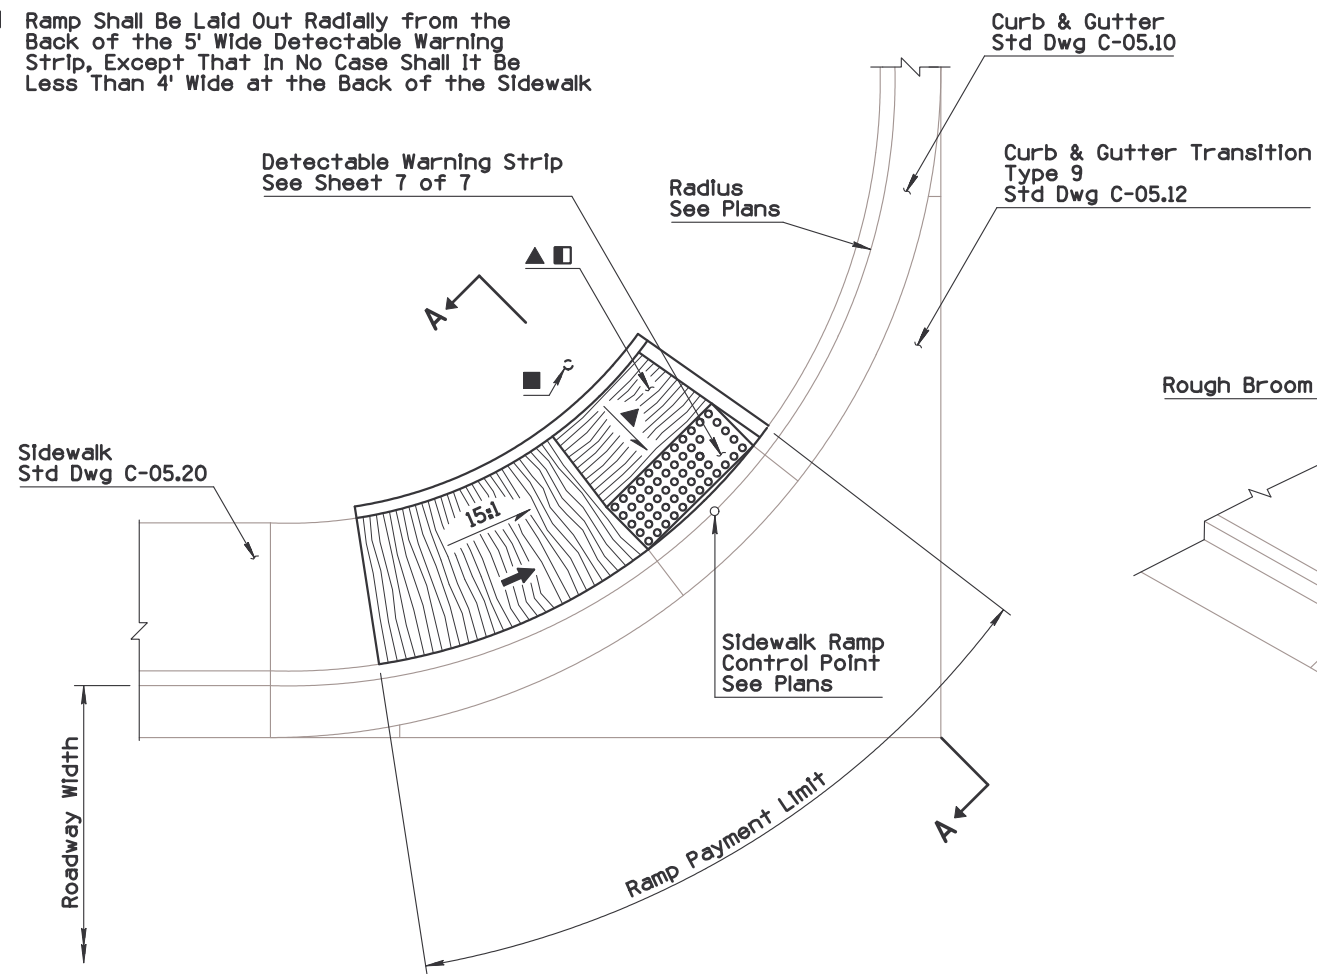


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
1	REISSUED STANDARD DRAWING AS SHEET 3 OF 7	RLF	9/04
2			
3			
4			

■ Ramp Shall Be Laid Out Radially from the Back of the 5' Wide Detectable Warning Strip, Except That In No Case Shall It Be Less Than 4' Wide at the Back of the Sidewalk

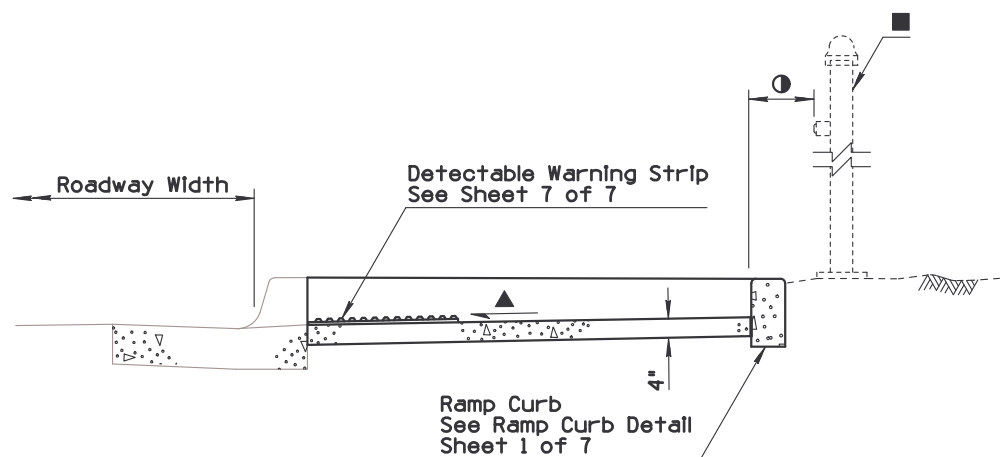

PERSPECTIVE

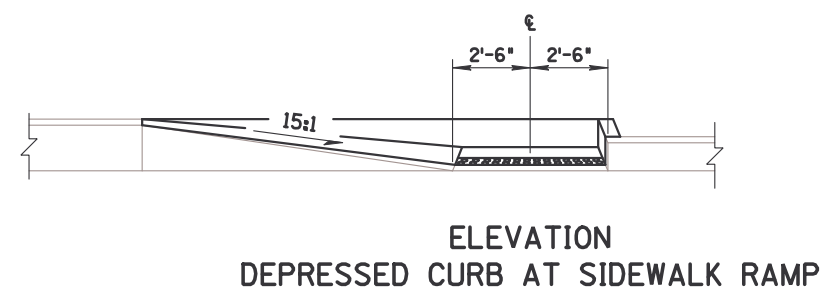

SECTION A-A

GENERAL NOTES

1. For use where sidewalk is not continuous.
2. Ramp centerline shall be radial from the face of the curb at the Sidewalk Ramp Control Point.
3. The 15:1 ramp slope measured at the back of sidewalk is the steepest allowed, except as provided for under Note 4.
4. Ramp lengths shall not exceed 10' for any installation. Ten-foot long ramps may be steeper than the slope shown in Note 3.
5. The top of the Ramp Curb along the back of the Sidewalk Ramp shall match the elevation of the adjacent back of sidewalk and run parallel to the Sidewalk Ramp. The Ramp Curb along the side of the Sidewalk Ramp shall match the elevation at the back of the Curb & Gutter and the back of Ramp Curb.
6. Drainage Inlets should not be located within the marked crosswalks, or if crosswalks aren't marked, within the area a standard marked crosswalk would enclose.
7. Concrete shall receive a rough broom finish as shown.
8. See Std Dwg C-05.10 and C-05.20 for joint details.
- Pedestrian Push Button Pole When Shown on Traffic Plans. See Traffic Signal Plans for Additional Information
- 10" Maximum to Face of Pedestrian Push Button

LEGEND

- ▲ Minimum Slope = 100:1 (0.01 '/ft)
- ➔ Maximum Slope = 50:1 (0.02 '/ft)

SIDEWALK RAMP AT SIDEWALK TERMINUS

APPROVED FOR DESIGN <i>Mary Viparina</i>	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	REV. 9/04
APPROVED FOR DISTRIBUTION <i>[Signature]</i>	SIDEWALK RAMP TYPE C	DRAWING NO. ① C-05.30 Sheet 3 of 7