


17.50"

Note 7, 8 and 9

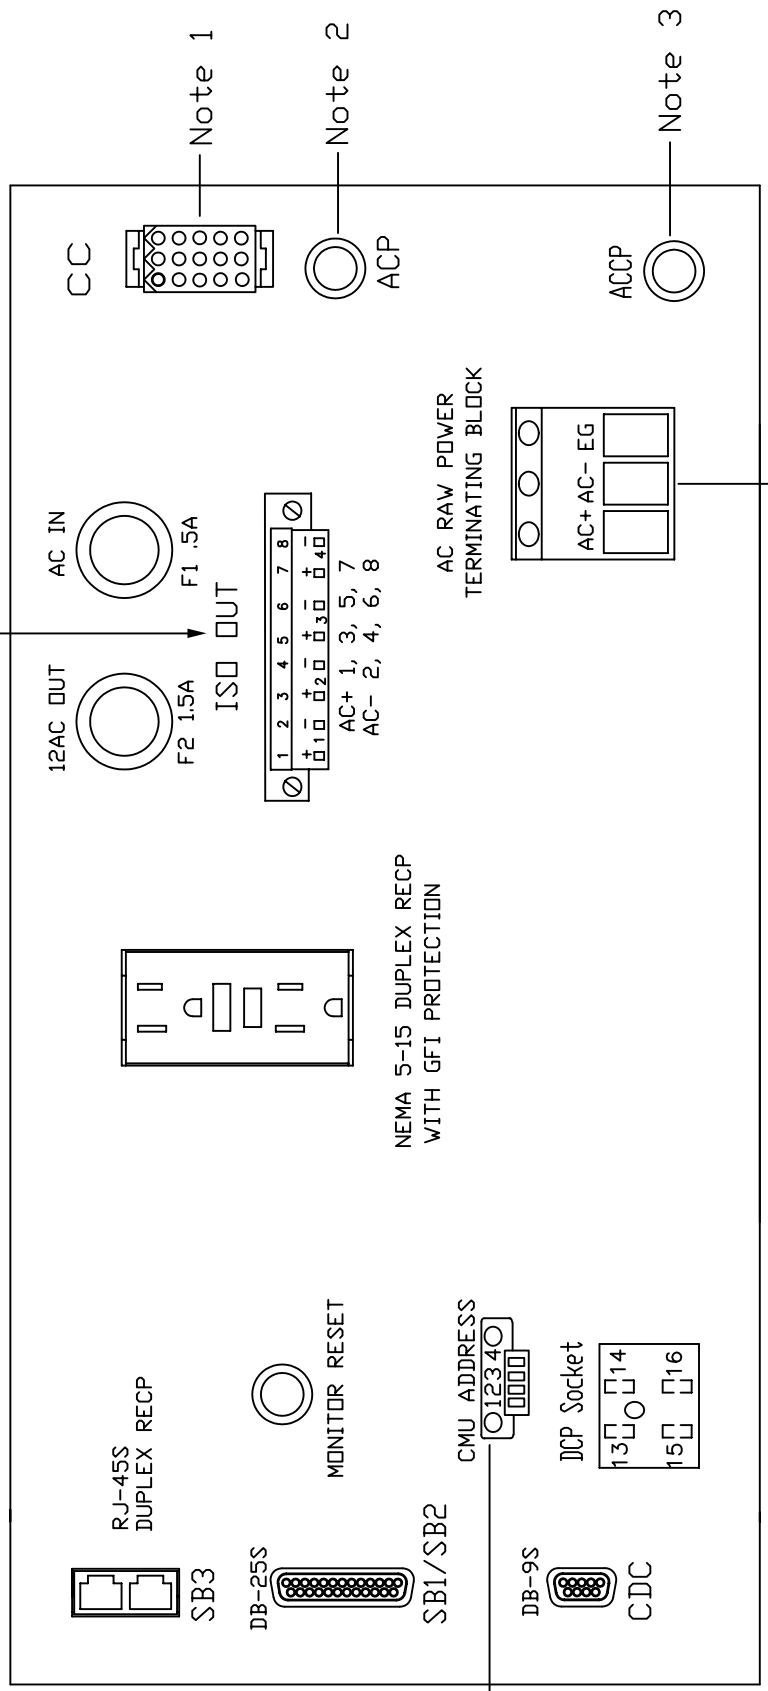

Note 5/6

Note 4

NOTES:

1. CC - External harness shall be minimum 18 inches with two Molex 1375 (03-09-2158) plug connectors or equal. Chassis Mounted connector socket is Molex 1375 (03-09-1154) panel mount assembly.
2. Harness shall be minimum 18 inches with BEAU S-5412-CCE connector or equal
3. AC Clean Power Harness shall be minimum 18 inches with a NEMA 5-15 Plug connector or equal
4. AC Raw Power connector shall be Phoenix Contact type HDFK 16A/HDFK16I or MAGNUM 14004-3 terminal block
5. ADDRESS Socket shall be 4 position Phoenix 3.81mm (18-29-36-1) or equal.
6. ADDRESS Plug shall be 4 position Phoenix 3.81mm (18-27-72-9) or equal.
7. 12VAC isolated power out for use with the CDC interface
8. F1 and F2 are bayonet fuses used to protect the input AC to the Isolation transformer and the 12VAC out.
9. Iso Terminal Block is an 8 position Phoenix 3.81mm (socket 18-27-59-6) (plug 18-27-76-1) to field interconnect isolated 12VAC.

TITLE:	
<b>PDA ITS REAR VIEW</b>	
NO SCALE	
April 14, 2004	<b>7-5-20LA</b>